


# Cooling Water Balance

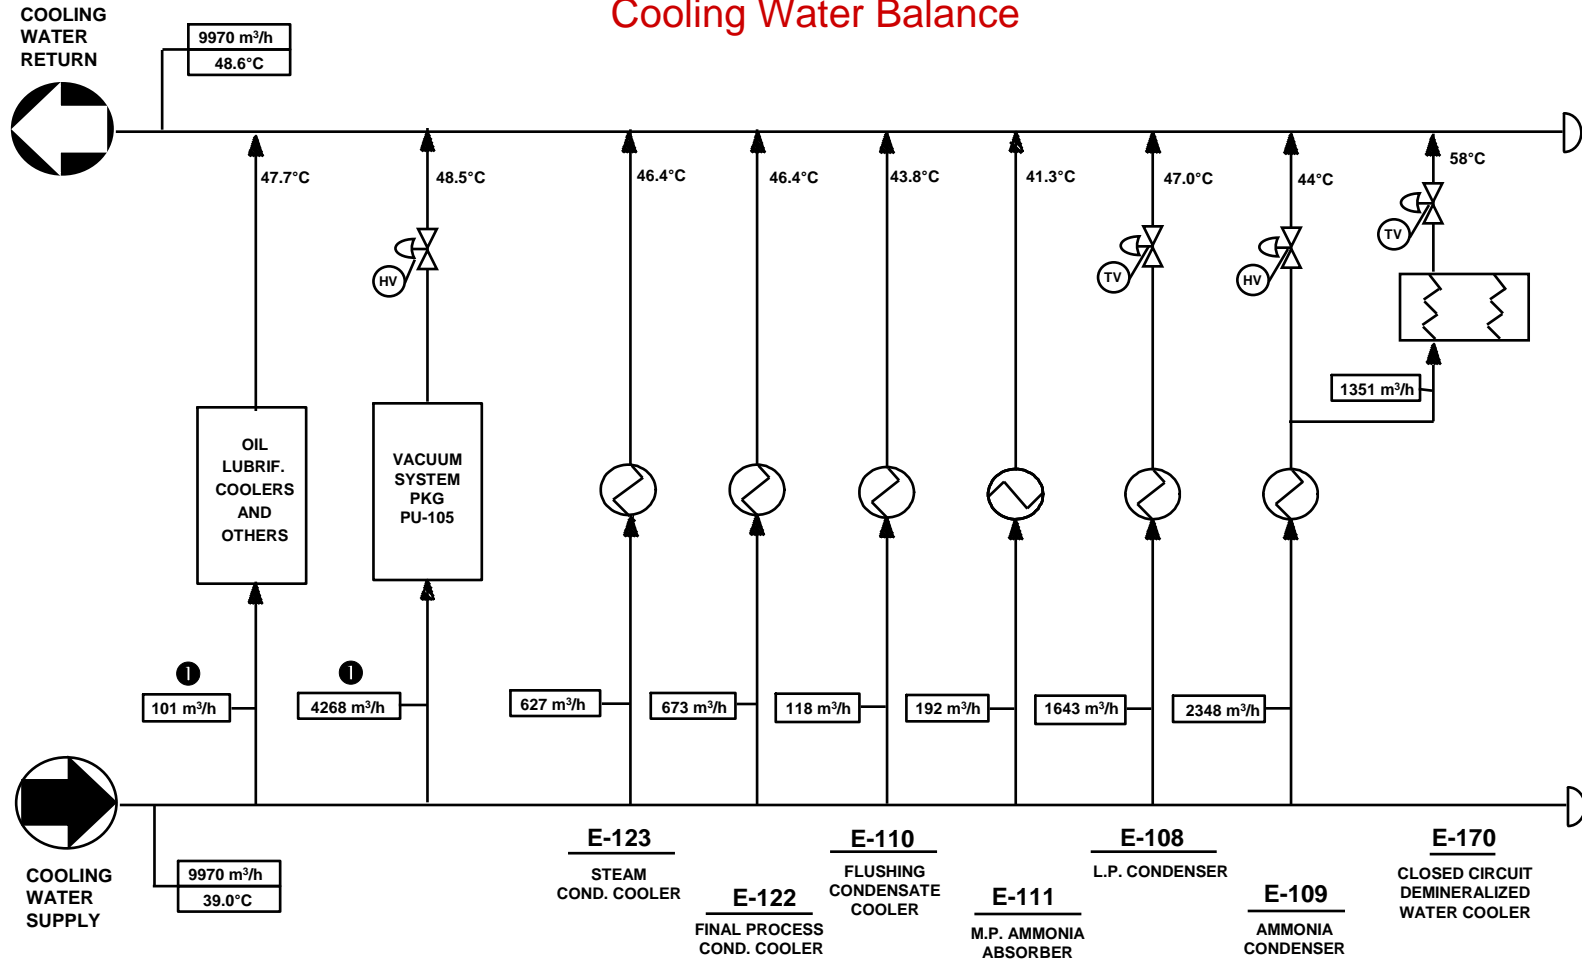

### NOTES

- ① TO BE CONFIRMED BY MANUFACTURER.
- ② RATED COOLING WATER CIRCULATION FLOW (WITH  $\Delta T=10^{\circ}\text{C}$ ): 11483 m³/h

**CONFIDENTIAL**

This document and the information herein contained are confidential and the sole property of Saipem who will safeguard its rights according to the civil and criminal provisions of the law. It shall neither be disclosed to third parties nor used for purposes other than those for which it has been disclosed.

0	27/05/16	ISSUE	RAMUNDO	TRICASE	CIANCI
REV.	DATE	DESCRIPTION	PREPARED	CHECKED	APPROVED
SNAMPROGETTI™ UREA TECHNOLOGY SAIPEM			DWG No. GD-D-06013 Sh. 1 of 1		
<b>HENGAM PETROCHEMICAL COMPANY</b> <b>ASSALUYEH, IRAN</b> <b>3500 MTPD GRANULATED UREA PROJECT</b>			Job <b>034001</b>		
<b>COOLING WATER BALANCE</b>			SCALE IN REPLACEMENT OF REPLACED BY		
Issuer Specific Number		/	Rev. 0		