


- NOTE 1 ALL SIGNALS WILL BE REPEATED IN FCS (BY REDUNDANT MODBUS)
- 2 FT16 AND 16G ARE 1 1/2" FLANGE TYPE AND ACCORDING TO ANSI BNS 3 EXCEPT FOR RATING 5500 AND HIGHER THAT ARE WELDED TYPE (IF ANY)
- 3 TEMPORARY STRAINER
- 4 AXIAL NON-SLAM CHECK VALVE
- 5 ALL INSTRUMENT TAG NUMBER HAVE PREFIX OF NO. 11. FOR EXAMPLE 11-TG-1054
- 6 THE UPSTREAM AND DOWNSTREAM OF FE IS 12D AND 4D
- 7 AS CLOSE AS POSSIBLE TO COMPRESSOR SUCTION
- 8 LSHH-10191 TO 10193 A/B/C HAVE SEPARATE NOZZLE CONNECTION FOR INSTALLING ON VESSEL
- 9 TO ALL THE MANUAL & CHECK VALVE IS STANDARD TYPE OF VALVE
- 10 FVHS-10131 WILL SEND HIGHER INPUT VALUE TO CONTROL VALVE AUTOMATICALLY OR MANUALLY SELECTABLE VALUE BY OPERATOR
- 11 TRIM LINE FOR 11-E-119A: 11-CWR1070-B24-V (SHELL SIDE); 11-CO21070-B50-N (TUBE SIDE)
- 11-E-119B: 11-CWR1071-B24-V (SHELL SIDE); 11-CO21071-B50-N (TUBE SIDE)
- 11-E-119C: 11-CWR1072-B24-V (SHELL SIDE); 11-CO21072-B50-N (TUBE SIDE)
- 12 TUBE RAPTURE

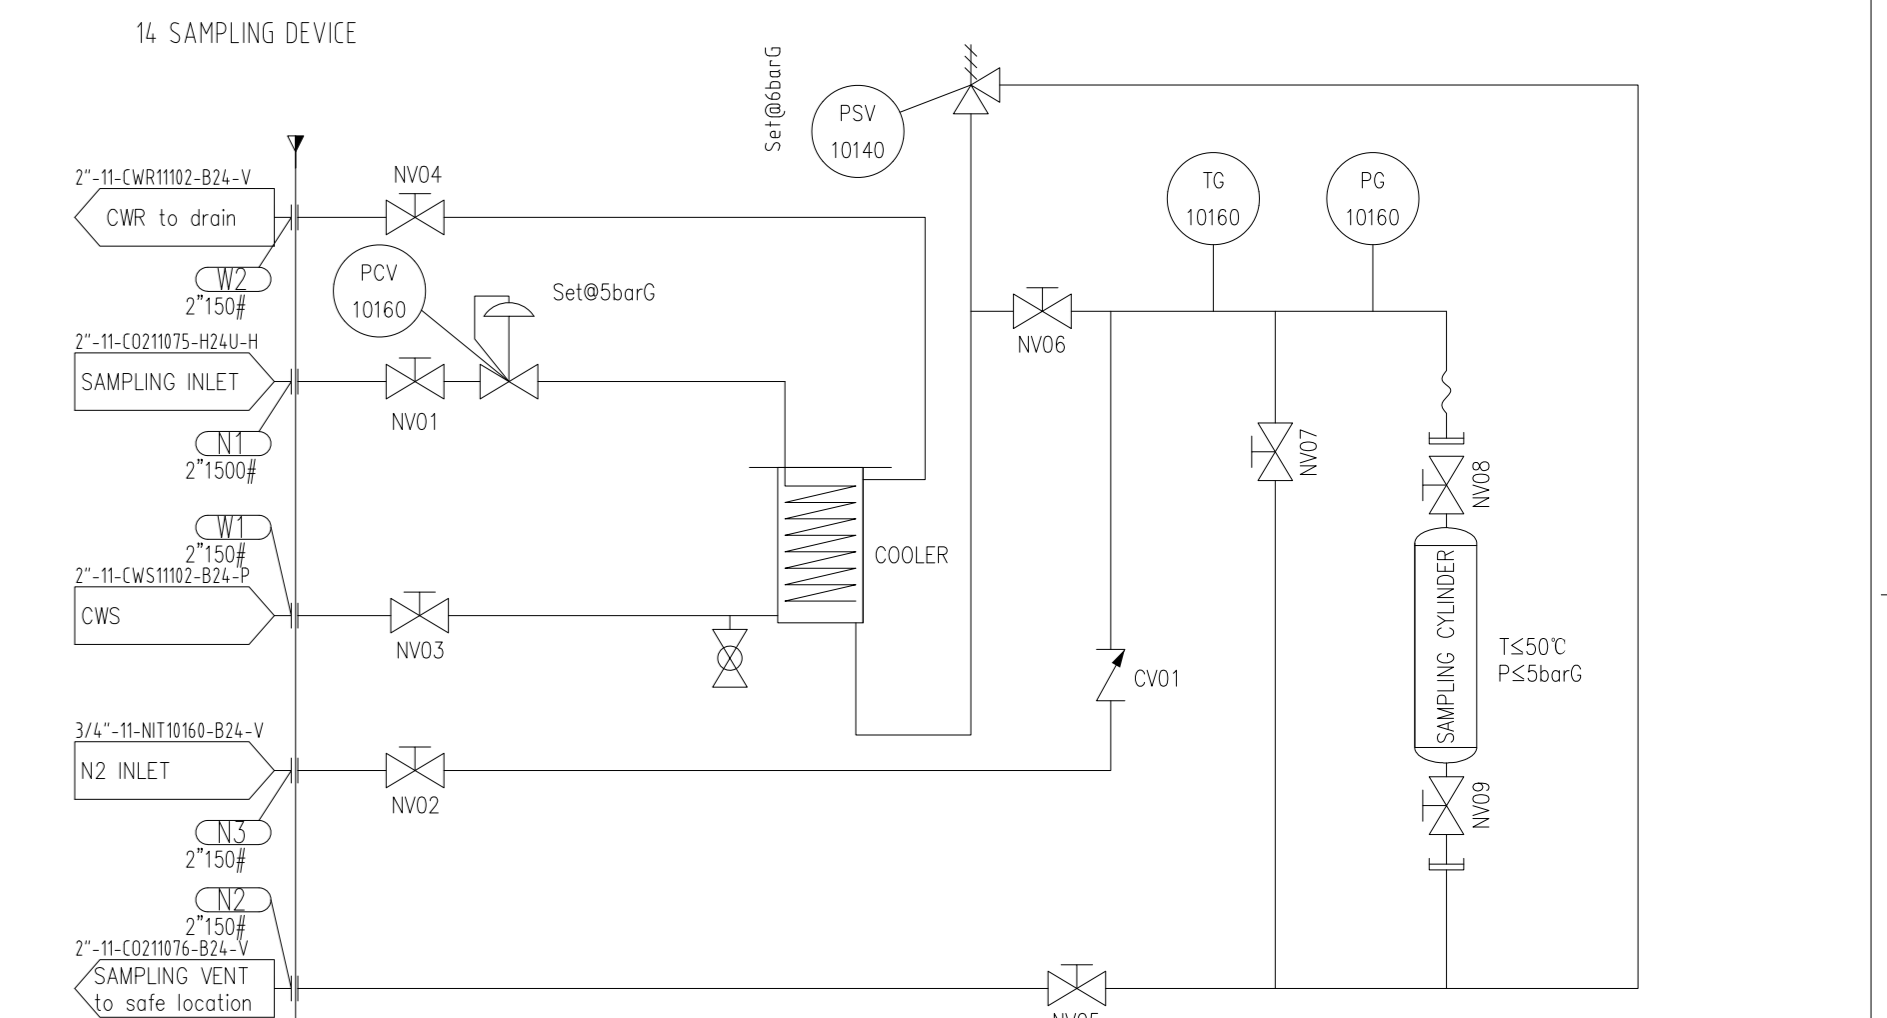

15 DIFFUSER FOR:
 11-HV-1038 6"X10", 10"X14", 14"X18", connection deliver @ 18" BW
 11-FV-1038 3"X4", 4"X6", 6"X10", 10"X16", connection deliver @ 6" BW

- No Comment
- Comment As Marked, Manufacturing May Proceed
- Major Comment As Marked, Manufacturing Shall Be On Hold For The Next Revision.
- Rejected, New Document With The Same Revision No. shall Be Issued
- For Information

Name: _____ Req. No.: _____ Seq. No.: _____
 Date: _____
 Purchaser review & comments does not absolve the vendor of the responsibility for the correct design, manufacturing and operation of the equipment.

DE	Eng. Phase	Purpose of Distribution (POD)	Purpose of Issue (POI)	Purchaser's Action
09	01.02.2024	ISSUED FOR APPROVAL	Sun-Hongmei	WuYang XieShuangjun WangZhiJun
08	22.11.2022	ISSUED FOR APPROVAL	Sun-Hongmei	WuYang XieShuangjun WangZhiJun
07	05.04.2022	ISSUED FOR APPROVAL	Sun-Hongmei	WuYang XieShuangjun WangZhiJun
06	19.10.2021	ISSUED FOR APPROVAL	Sun-Hongmei	WuYang XieShuangjun WangZhiJun
05	15.10.2019	ISSUED FOR APPROVAL	YangXiaokang	WuQing XieShuangjun WangZhiJun

REV.	ISSUE DATE	DESCRIPTION	PREPARED BY	CHECKED BY	APPROVED BY	AUTHORIZED BY
OWNER:						
MC:						
EPCC CONTRACTOR:						

PROJECT: **HENGAM FERTILIZER PROJECT**

VENDOR: **NEWJCM 锦州新锦化机械制造有限公司**
 Jinzhou NEWJCM Machinery manufacture Co.,Ltd

TITLE: **PIPING AND INSTRUMENT DIAGRAM CO2 COMPRESSOR (11-C-101)**

SCALE: 1/40	OWNER PROJECT NO.: NA	VENDOR DWG. NO.:	REV: 09	SIZE: A1
SHT.: 2 OF 2	PIDEC PROJECT NO.: 1208	PIDEC DWG. NO.: VD-1208-301B-PID-401		