

NOTE 1:

NOTE 2: ALL SIGNALS WILL BE REPEATED IN FCS (By Redundant Modbus).

NOTE 3: BEFORE 12D, AFTER 4D

NOTE 4: TT(S) AND TG(S) ARE 1 1/2" FLANGE TYPE ACCORDING TO ANSI B16.5, EXCEPT FOR RATING 1500# AND HIGHER THAT ARE WELDED TYPE (IF ANY)

NOTE 5: ALL INSTRUMENT TAG NUMBERS HAVE PREFIX NO. OF 11. FOR EXAMPLE 11-LV-10105A

NOTE 6: ALL THE MANUAL & CHECK VALVE IS STANDARD TYPE OF VALVE.

NOTE 7: ALARM IS INITIATED IN CASE OF 10% DEVIATION BETWEEN LI-10105A AND LI-10105B

- No Comment
- Comment As Marked, Manufacturing May Proceed
- Major Comment As Marked, Manufacturing Shall Be On Hold For The Next Revision.
- Rejected, New Document With The Same Revision No. shall be Issued
- For Information

Name: _____ Reg. No.: _____ Seq. No.: _____
 Signature: _____ Date: _____
 Purchaser review & comments does not absolve the vendor of the responsibility for the correct design, manufacturing and operation of the equipment.

DE	Eng. Phase	Purpose of Distribution (POD)	Purpose of Issue (POI)	Purchaser's Action
07	25.07.2022	ISSUED FOR APPROVAL	SunHongmei, WuQing, XieShuangjun, WangZhenjun	
06	10.08.2021	ISSUED FOR APPROVAL	SunHongmei, WuQing, XieShuangjun, WangZhenjun	
05	09.01.2020	ISSUED FOR APPROVAL	SunHongmei, WuQing, XieShuangjun, WangZhenjun	
04	15.08.2016	ISSUED FOR APPROVAL	SunHongmei, WuQing, XieShuangjun, WangZhenjun	
03	31.12.2015	ISSUED FOR APPROVAL	SunHongmei, WuQing, XieShuangjun, WangZhenjun	

OWNER:

MC:


EPCC CONTRACTOR:

PROJECT: **HENGAM FERTILIZER PROJECT**

VENDOR: **NEWJCM 锦州新锦化机械制造有限公司**
 Jinzhou NEWJCM Machinery manufacture Co., Ltd

TITLE: **TURBINE STEAM CONDENSER PID CO2 COMPRESSOR (11-C-101)**

SCALE: N.T.S.	OWNER PROJECT NO.: NA	VENDOR DWG. NO.:	REV. SIZE:
SHT.: 1 OF 1	PIDEC PROJECT NO.: 1208	PIDEC DWG. NO.: VD-1208-301B-PID-407	07 A1

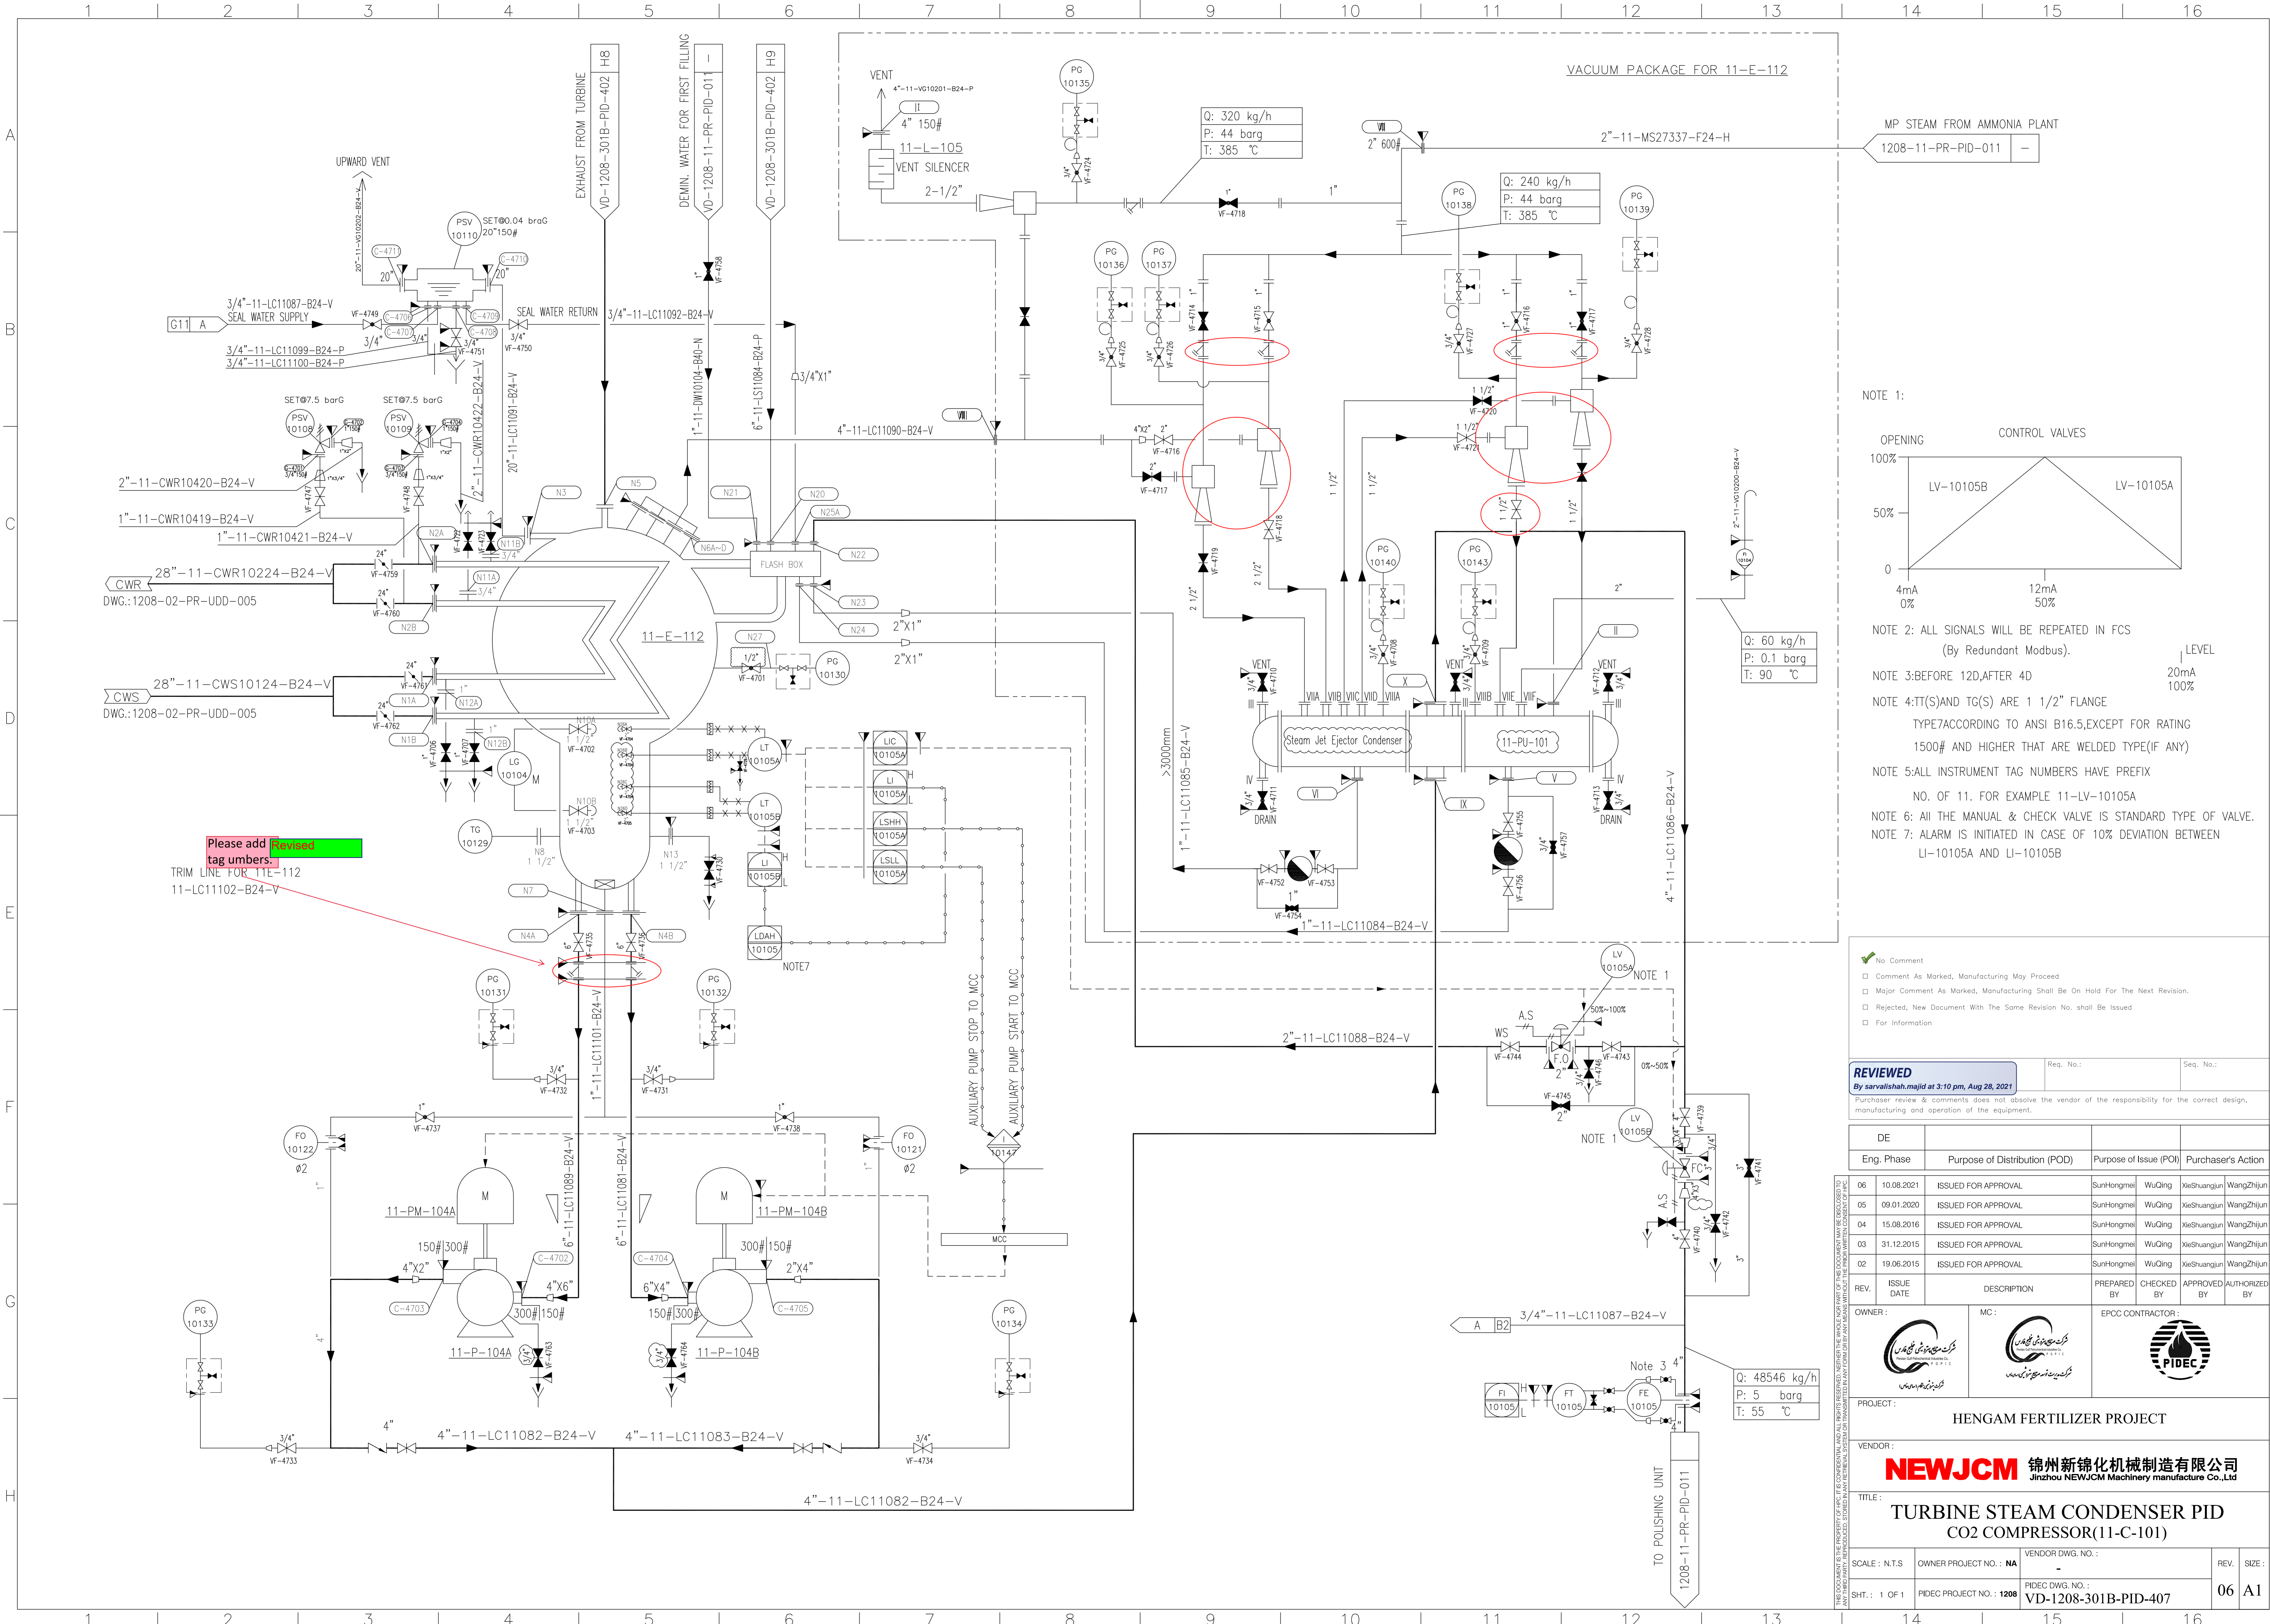

NOTE 1:

OPENING CONTROL VALVES

100%
50%
0

4mA 0% 12mA 50%

NOTE 2: ALL SIGNALS WILL BE REPEATED IN FCS (By Redundant Modbus).

NOTE 3: BEFORE 12D, AFTER 4D

NOTE 4: TT(S) AND TG(S) ARE 1 1/2" FLANGE TYPE 7 ACCORDING TO ANSI B16.5, EXCEPT FOR RATING 1500# AND HIGHER THAT ARE WELDED TYPE (IF ANY)

NOTE 5: ALL INSTRUMENT TAG NUMBERS HAVE PREFIX NO. OF 11. FOR EXAMPLE 11-LV-10105A

NOTE 6: ALL THE MANUAL & CHECK VALVE IS STANDARD TYPE OF VALVE.

NOTE 7: ALARM IS INITIATED IN CASE OF 10% DEVIATION BETWEEN LI-10105A AND LI-10105B

- No Comment
- Comment As Marked, Manufacturing May Proceed
- Major Comment As Marked, Manufacturing Shall Be On Hold For The Next Revision.
- Rejected, New Document With The Same Revision No. shall Be Issued
- For Information

REVIEWED
By sarvalshah.majid at 3:10 pm, Aug 28, 2021

Purchaser review & comments does not absolve the vendor of the responsibility for the correct design, manufacturing and operation of the equipment.

DE	Eng. Phase	Purpose of Distribution (POD)	Purpose of Issue (POI)	Purchaser's Action
06	10.08.2021	ISSUED FOR APPROVAL	SunHongmei WuQing XieShuangjun WangZhiJun	
05	09.01.2020	ISSUED FOR APPROVAL	SunHongmei WuQing XieShuangjun WangZhiJun	
04	15.08.2016	ISSUED FOR APPROVAL	SunHongmei WuQing XieShuangjun WangZhiJun	
03	31.12.2015	ISSUED FOR APPROVAL	SunHongmei WuQing XieShuangjun WangZhiJun	
02	19.06.2015	ISSUED FOR APPROVAL	SunHongmei WuQing XieShuangjun WangZhiJun	

REV.	ISSUE DATE	DESCRIPTION	PREPARED BY	CHECKED BY	APPROVED BY	AUTHORIZED BY
06	10.08.2021	ISSUED FOR APPROVAL	SunHongmei	WuQing	XieShuangjun	WangZhiJun
05	09.01.2020	ISSUED FOR APPROVAL	SunHongmei	WuQing	XieShuangjun	WangZhiJun
04	15.08.2016	ISSUED FOR APPROVAL	SunHongmei	WuQing	XieShuangjun	WangZhiJun
03	31.12.2015	ISSUED FOR APPROVAL	SunHongmei	WuQing	XieShuangjun	WangZhiJun
02	19.06.2015	ISSUED FOR APPROVAL	SunHongmei	WuQing	XieShuangjun	WangZhiJun

OWNER:

MC:

EPC CONTRACTOR:

PROJECT: **HENGAM FERTILIZER PROJECT**

VENDOR: **NEWJCM 锦州新锦化机械制造有限公司**
Jinzhou NEWJCM Machinery manufacture Co.,Ltd

TITLE: **TURBINE STEAM CONDENSER CO2 COMPRESSOR(11-C-101)**

SCALE: N.T.S	OWNER PROJECT NO.: NA	VENDOR DWG. NO.:	REV.:	SIZE:
SHT.: 1 OF 1	PIDEC PROJECT NO.: 1208	PIDEC DWG. NO.: VD-1208-301B-PID-407	06	A1